



Village of New Denver

2023 Annual Water Report

Compiled by Water System Operator:
Keith Macaulay
May 2024

Table of Contents

Page 1	Table of Contents
Page 2	Introduction
Page 3	Water Supply System Overview
Page 3	Water System Operators
Page 3	Cross Connection Control Program Summary
Page 4	Distribution System Improvement Plan Summary
Page 4	Source Protection Summary
Page 4	Emergency Response Plan Summary
Page 4	Monthly Reports and Trends Summary
Page 5	Water Use
Page 5	Water Quality Monitoring Summary
Page 6	System Anomalies
Page 6	Comprehensive Testing
Page 7	System Maintenance
Page 8	Future Equipment Replacement Costs
Page 8	Estimated Cost of System Replacement
Page 9	Annual Water System Emergency Response Plan Update
Appendix A	Latest Comprehensive Water Testing Report 2013
Appendix B	Passmore Laboratory Sample Report
Appendix C	Annual Water System Emergency Response Plan (redacted)

Introduction

The annual report covers the period from January 1, 2023 to December 31, 2023. The report aims to convey information to residents regarding the overall operation of the municipal water system and describe the Village's approach to the operation and maintenance of the water system.

This report has been published to meet the requirement for water suppliers to produce an annual report on water quality as per Section 15 of the Drinking Water Protection Act and Section 11 of the Drinking Water Protection Regulation, and to comply with the conditions on the Permit to Operate.

The Village of New Denver, from now on referred to as “the Village”, operates Facility Number 0210710 under the Permit to Operate issued by Interior Health. To validate the Permit to Operate, the Village must comply with the following conditions;

Permit to Operate Requirements

1. To provide a protection plan for each water source,
2. To provide a certified operator to operate the system,
3. To operate according to our Water Quality Monitoring Program,
4. To operate according to our Cross Connection Control Program,
5. To provide long term plans for source and distribution system,
6. To review and update the Emergency Response Plan annually,
7. To provide monthly reports to the Interior Health Authority
8. To submit an annual report summary to the public and Interior Health Authority.

Websites

For more detailed information on drinking water regulations, the Village recommends viewing the following websites:

CBT Water Smart

<http://www.cbt.org/watersmart/cm-newdenver.asp>

Health Canada

<http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/index-eng.php>

Interior Health Authority

<http://www.interiorhealth.ca/YourEnvironment/DrinkingWater/Pages/default.aspx>

Water Supply System Overview

Pure, untreated, potable water is supplied to New Denver by two municipal wells.

Well #1, is located on Kootenay Street south of Highway 31A and was constructed in October, 1974. The well has a depth of 42m and it is considered a medium capacity well with an estimated safe yield of 660 L/min. The pump in the well was installed in October, 2008 and has a pumping capacity of 660 L/min. This well is the village's main water supply and has a diesel generator for backup power in the event of a power outage.

Well #2, is located between Slocan Lake and Eldorado Avenue and was constructed in November 1974. It has a depth of 33.6m and it is considered a high capacity well with an estimated safe yield of 3790 L/min. The pump in the well was installed in October 2010 and has a pumping capacity of 1890 L/min. This well is considered our secondary or backup well during periods of high-water demand, such as the summer season, or in the event that the primary pump in well #1 fails.

The distribution system consists of various diameters of **Ductile Iron (DI)** and **Poly-Vinyl Chloride (PVC)** and Steel pipes. A bolted steel reservoir, located on the high end of the distribution system, was completed on March 1st, 2010 and has a capacity of 1230 m³ or 1,230,000 L. Water is pumped from the wells directly into the water distribution system, filling the reservoir while simultaneously supplying required demand. There are 35 fire hydrants with 150mm leads located throughout the Village.

In 2022 a boundary extension saw the amalgamation of the Village system with the Denver Siding system which had previously been maintained by the RDCK and was fed by 3 creeks. This extension added a two chamber, inground, concrete reservoir with a capacity of 36,00 USG, 7 fire hydrants and 22 service connections. Pipe is comprised of **Poly-Vinyl Chloride (PVC)**, **High Density Polyethylene (HDPE)**, Steel and **Asbestos Cement (AC)**. A pump house was constructed within the New Denver reservoir enclosure that houses two pumps rated at 53.3GPM with a generator for back-up power. Water is pumped directly from the New Denver system into the Siding system. Decommissioning of the old intakes from was carried out in 2023.

Water System Operators

The Village currently operates a Class I Water Distribution System. Operators of this system must be certified through the Environmental Operators Certification Program (EOCP). Our two water system operators are members in good standing and stay current by obtaining the necessary yearly training. Keith Macaulay holds a Water Distribution Level 1 certification. Robby James holds a Small Water Systems certification while working towards his Level 1. Having two qualified operators allows for 24/7 coverage in the event of emergencies or absenteeism.

Cross Connection Control Program Summary

Cross connections are a concern to water suppliers because they may be a source for system contamination. When a water distribution main experiences a reduction in pressure or the pressure applied at a connection exceeds the system pressure, backflow can occur, potentially contaminating the system. Potential sources identified as “high risk” have been isolated from the main supply system with the installation of back-flow preventers to prevent potential cross contamination.



Ideally, all private and commercial connections to the water distribution system should have a back-flow preventer but monetary constraints and the amount of infrastructure work it would take to accomplish this task is a challenge for all small communities. Currently the Village is requiring backflow prevention devices on any new connections.

Distribution System Improvement Plan Summary

The Village accomplished many upgrades to its system over the past year. Two new wells were drilled in the vicinity of the #1 pumphouse. Those wells will be brought online in 2024 to replace both existing Village wells. Another major upgrade was the installation of four new fire hydrants. Two of those hydrants were installed as part of an emergency overland line that can be temporarily put in place in the event of a failure of the line that services the Orchard that is suspended under the bridge over Carpenter Creek. Plans and engineering are underway to replace the 6” main under the bridge in 2024. Plans are also underway for the installation of blow offs for two of the dead ends in the system.

Source Protection Summary

The Village commissioned a study on well head protection in 1998 and a storm water runoff impact study in 2004. As a result, the Village has adopted a Well and Ground Water Protection Plan which is designed to prevent contamination of our drinking water sources. A Ground Water Protection and Monitoring program is currently being developed and will incorporate scheduled yearly comprehensive water sampling and well level monitoring devices to develop a baseline and to record changes in the aquifer quality and level.

Emergency Response Plan Summary

The revised Water Distribution Emergency Response Plan for the Village has been completed as of January 2023, and features an updated contact list, updated emergency procedures, disinfection procedures, a water system incident report program and public advisories.

Monthly Reports and Trends Summary

Total water use for the year 2023 was 41.3 Million USG or 153 Million Litres.
Total water use for the year 2022 was 35.3 Million USG or 134 Million Litres.
Total water use for the year 2021 was 34.1 Million USG or 126 Million Litres.


2023 Water Consumption in US Gallons/Month

January	February	March	April	May	June
2,177,474	1,913,957	1,828,133	1,483,734	5,403,347	6,716,991
July	August	September	October	November	December
7,661,801	6,392,332	3,058,387	1,625,652	1,571,587	1,492,767

Water Use

“In 2021, the average Canadian daily domestic use of fresh water per capita was 401 litres.”
-Environment Canada

In comparison, the average daily water use per capita (using an average population of 750 residents, accounting for summer time visitors) at the Village is 567 litres. Note that this figure includes residential, commercial and industrial use as well as potential unknown leakage. Also of note is the increase in consumption since the amalgamation with the Denver Siding which occurred in mid 2022.

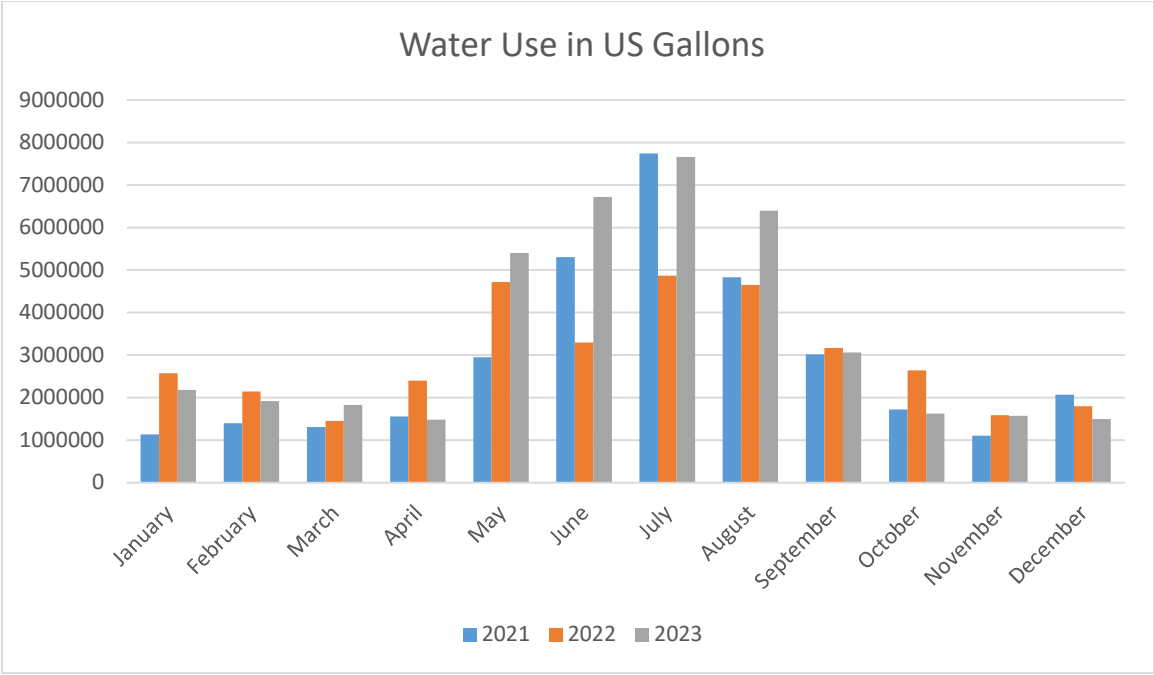

Water Quality Monitoring Summary

As a requirement of the Permit to Operate and the Drinking Water Protection Regulation, the Village is required to have a Water Quality Monitoring Program. The components of this testing program are:

1. Monitor the drinking water source, the water in its system and the water it delivers.
2. Monitor the fore-mentioned, not less than 4 times per month, for both Total Coliform bacteria and E. Coli.
3. Have the analyses required for monitoring carried out by an accredited laboratory.
4. Send monthly reports to the Public Health Officer that summarize the results and daily water consumption totals.

5 These tests are conducted on a weekly basis from two different sampling sites. One sample is taken from New Denver while another is taken from the Denver Siding. Water samples are collected alternately from the Village Office, the Nikkei Internment Memorial Centre, and the Slocan Community Health Centre (Hospital). These sites provide representative, “end of line” samples for each sector in the distribution system. Denver

Siding samples are taken from private residences. Water samples are sent to Passmore Laboratories for testing. Passmore Laboratories then send the water sample reports to the Village and to IHA to be reviewed for anomalies. The Village compiles the results and in addition to other pertinent information then sends a monthly report to IHA.

Microbiological parameters for test results have been established by Health Canada in the form of a maximum allowable concentration (MAC). Each MAC has been designed to safeguard human health and is based on projecting lifelong consumption of drinking water that contains the substances at the maximum concentration level. These MAC’s are identified in Schedule A of the Drinking Water Protection Regulation as follows:

<i>Escherichia coli</i> (<i>E. coli</i>)	MAC: None detectable per 100 mL
Total coliforms	No consecutive samples(100mL) or no more than 10% of samples should contain total coliforms

Comprehensive Testing

In addition to testing for E.Coli and Coliforms the Village has, over the years, done some in depth chemical analysis of the water composition. This analysis is now being completed biennially.

System Maintenance

Several items are addressed annually to ensure the supply system functions properly and problems can be addressed before they become major defects. This is known as preventative maintenance. Some of these items include:

- The fire hydrants are operated to ensure proper function of the valves and components.
- Hydrants are also an important tool to flush the water system which helps remove any sediment or particles that may be adhering to the pipe walls.
- The backup generator is serviced annually and run on a monthly basis to ensure proper operation.
- The reservoir is checked on a daily basis and a visual internal inspection is done monthly. A thorough reservoir inspection, including the use of an ROV is being completed bi-annually by a contractor. Tank cleaning will be conducted as required.
- Valves in the system are exercised yearly to improve valve reliability, reduce water loss and ensure system isolation capability.
- Certain backflow preventers must be serviced annually by a certified inspector and documented for compliance.

Future Equipment Replacement Costs

The equipment involved in the system includes the pipes, pumps, pump houses, butterfly valves, gate valves, electronic monitoring equipment, meters, fire hydrants, and a water reservoir. This equipment is designed to have a relatively long life cycle but environmental factors can make a difference.

Most of the Villages water system was replaced in 1976 and has been periodically checked for degradation of its parts. Soil conditions in this area are not acidic and conducive to corrosion therefore the water system infrastructure is in relatively good shape. In consideration of the overall age of the system however we have made inquiries into how much replacements would be.

Following is a list of the estimated costs for replacing parts and equipment involved in the system. It is important to note that the estimates do not include the elbows, T- Joints, bedding sand, rental of construction equipment/vehicles, labour contracting or inflation.

Estimated Cost of System Replacement

EQUIPMENT TYPE	UNITS	COST	VALUE
6 Inch Pipes	4700m	\$300	\$1,410,000
8 Inch Pipes	2400m	\$500	\$1,200,000
6 Inch Gate Valves	105	\$1500	\$157,500
8 Inch Gate Valves	29	\$2500	\$72,500
Fire Hydrants	35	\$5500	\$192,500
Water Reservoir	2	\$800,000	\$800,000
Pumps	4	\$10,000	\$40,000
Meters	3	\$5000	\$15,000
Electronic Equip.		\$80,000	\$80,000
		Total Estimate	\$3,967,500