

CERTIFICATE OF ANALYSIS

REPORTED TO Keith Macaulay (New Denver, Village of)
115 Slocan Avenue
NEW DENVER, BC V0G 1S0

ONLINE ORDER# 512049

SITE INFO Online Order#512049
CARO WO# 25K0075

RECEIVED / TEMP 2025-11-24 11:03 / 5.4°C
REPORTED 2025-11-28

Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO/IEC 17025:2017 for specific tests listed in the scope of accreditation approved by CALA.

Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

Ahead of the Curve



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.

Report Highlights:

The results in this report apply to the samples analyzed in accordance with your submission. All parameters meet the Guidelines for Canadian Drinking Water Quality (Jan 2020).

For more information, please visit <http://www.caro.ca/reports/>

By engaging our services, you are agreeing to CARO Analytical Service's Standard Terms and Conditions outlined here:
<https://www.caro.ca/terms-conditions>

Laboratory Recommendations:

For assistance reading your report, please visit

<https://www.caro.ca/wp-content/uploads/2020/07/How-to-read-your-report-1.pdf>

For information about bacteria in water results, please visit

<https://www.caro.ca/you-need-to-know-about-bacteria-in-water-analytical-report/>

If you have any additional questions or concerns, please contact me at hhannaoui@caro.ca.

Authorized By:

Hanane El Hannaoui
Junior Account Manager



1-888-311-8846 | www.caro.ca

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7 |
#108 4475 Wayburne Drive Burnaby, BC V5G 4X4

TEST RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Parameter	Result	Guideline	RL	Units	Analyzed	Note
-----------	--------	-----------	----	-------	----------	------

Sample Name: New Denver | Matrix: Drinking Water | Sampled: 2025-11-24 05:55

Anions

Chloride	0.36	AO ≤ 250	0.10	mg/L	2025-11-24	
Fluoride	< 0.10	MAC = 1.5	0.10	mg/L	2025-11-24	
Nitrate (as N)	< 0.010	MAC = 10	0.010	mg/L	2025-11-24	
Nitrite (as N)	< 0.010	MAC = 1	0.010	mg/L	2025-11-24	
Sulfate	22.9	AO ≤ 500	1.0	mg/L	2025-11-24	

Calculated Parameters

Hardness, Total (as CaCO ₃)	103	None Required	0.500	mg/L	N/A	
Langelier Index	-1.0	N/A	-5.0		2025-11-26	CT6
Nitrogen, Organic	0.247	N/A	0.0500	mg/L	N/A	
Solids, Total Dissolved	119	AO ≤ 500	1.00	mg/L	N/A	

General Parameters


Alkalinity, Total (as CaCO ₃)	93.4	N/A	1.0	mg/L	2025-11-25	
Ammonia, Total (as N)	< 0.050	None Required	0.050	mg/L	2025-11-25	
Carbon, Total Organic	< 0.50	N/A	0.50	mg/L	2025-11-25	
Colour, True	< 5.0	AO ≤ 15	5.0	CU	2025-11-25	
Conductivity (EC)	214	N/A	2.0	µS/cm	2025-11-25	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020	mg/L	2025-11-25	
Nitrogen, Total Kjeldahl	0.247	N/A	0.050	mg/L	2025-11-27	
pH	7.11	7.0-10.5	0.10	pH units	2025-11-25	HT2
Phosphorus, Total (as P)	< 0.0050	N/A	0.0050	mg/L	2025-11-27	
Turbidity	0.15	OG < 1	0.10	NTU	2025-11-24	
UV Transmittance @ 254 nm - Unfiltered	100	N/A	0.10	% T	2025-11-24	

Microbiological Parameters

Coliforms, Total	< 1	MAC = 0	1	CFU/100 mL	2025-11-24	
Background Colonies	< 1	N/A	1	CFU/100 mL	2025-11-24	
E. coli	< 1	MAC = 0	1	CFU/100 mL	2025-11-24	

Total Metals

Aluminum, total	< 0.0050	OG < 0.1	0.0050	mg/L	2025-11-25	
Antimony, total	0.00040	MAC = 0.006	0.00020	mg/L	2025-11-25	
Arsenic, total	< 0.00050	MAC = 0.01	0.00050	mg/L	2025-11-25	
Barium, total	0.0132	MAC = 2	0.0050	mg/L	2025-11-25	
Boron, total	< 0.0500	MAC = 5	0.0500	mg/L	2025-11-25	
Cadmium, total	0.000024	MAC = 0.007	0.000010	mg/L	2025-11-25	
Calcium, total	30.9	None Required	0.20	mg/L	2025-11-25	
Chromium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2025-11-25	
Copper, total	0.00343	MAC = 2	0.00040	mg/L	2025-11-25	
Iron, total	< 0.010	AO ≤ 0.1	0.010	mg/L	2025-11-25	
Lead, total	0.00026	MAC = 0.005	0.00020	mg/L	2025-11-25	
Magnesium, total	6.18	None Required	0.010	mg/L	2025-11-25	
Manganese, total	< 0.00020	MAC = 0.12	0.00020	mg/L	2025-11-25	

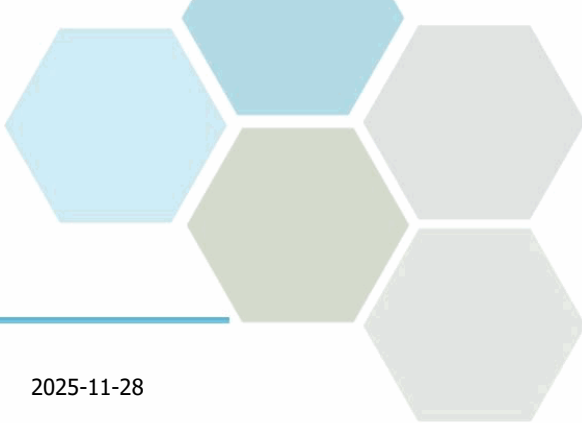

TEST RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Parameter	Result	Guideline	RL	Units	Analyzed	Note
Sample Name: New Denver Matrix: Drinking Water Sampled: 2025-11-24 05:55, Continued						
Total Metals, Continued						
Mercury, total	< 0.000010	MAC = 0.001	0.000010	mg/L	2025-11-26	
Potassium, total	0.53	N/A	0.10	mg/L	2025-11-25	
Selenium, total	0.00180	MAC = 0.05	0.00050	mg/L	2025-11-25	
Sodium, total	1.62	AO ≤ 200	0.10	mg/L	2025-11-25	
Strontium, total	0.236	MAC = 7	0.0010	mg/L	2025-11-25	
Uranium, total	0.000609	MAC = 0.02	0.000020	mg/L	2025-11-25	
Zinc, total	0.0046	AO ≤ 5	0.0040	mg/L	2025-11-25	

Note Descriptions:

- CT6

Results were based on lab temperature & lab pH.
- HT2

The 15 minute recommended holding time (from sampling to analysis) has been exceeded - field analysis is recommended.

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075


REPORTED 2025-11-28

Analysis Description	Method Ref.	Technique	Accredited	Location
Alkalinity in Water	SM 2320 B* (2021)	Titration with H2SO4	✓	Kelowna
Ammonia, Total in Water	SM 4500-NH3 G* (2021)	Automated Colorimetry (Phenate)	✓	Kelowna
Anions in Water	SM 4110 B (2020)	Ion Chromatography	✓	Kelowna
Carbon, Total Organic in Water	SM 5310 B (2022)	Combustion, Infrared CO2 Detection	✓	Kelowna
Coliforms, Total in Water	SM 9222* (2015)	Membrane Filtration / Chromocult Agar	✓	Kelowna
Colour, True in Water	SM 2120 C (2021)	Spectrophotometry (456 nm)	✓	Kelowna
Conductivity in Water	SM 2510 B (2021)	Conductivity Meter	✓	Kelowna
Cyanide, SAD in Water	ASTM D7511-12	Flow Injection with In-Line UV Digestion and Amperometry	✓	Kelowna
E. coli in Water	SM 9222* (2015)	Membrane Filtration / Chromocult Agar	✓	Kelowna
Hardness in Water	SM 2340 B* (2021)	Calculation: 2.497 [total Ca] + 4.118 [total Mg] (Est)	✓	N/A
Langelier Index in Water	SM 2330 B (2021)	Calculation		N/A
Mercury, total in Water	EPA 245.7*	BrCl2 Oxidation / Cold Vapor Atomic Fluorescence Spectrometry (CVAFS)	✓	Richmond
Nitrogen, Total Kjeldahl in Water	SM 4500-Norg D* (2021)	Block Digestion and Flow Injection Analysis	✓	Kelowna
pH in Water	SM 4500-H+ B (2021)	Electrometry	✓	Kelowna
Phosphorus, Total in Water	SM 4500-P B.5* (2011) / SM 4500-P F (2021)	Persulfate Digestion / Automated Colorimetry (Ascorbic Acid)	✓	Kelowna
Solids, Total Dissolved in Water	SM 1030 E (2021)	SM 1030 E		N/A
Total Metals in Water	EPA 200.2 / EPA 6020B	HNO3+HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	✓	Richmond
Transmittance at 254 nm - Unfiltered in Water	SM 5910 B* (2021)	Ultraviolet Absorption	✓	Kelowna
Turbidity in Water	SM 2130 B (2020)	Nephelometry	✓	Kelowna

Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method

Glossary:

RL	Reporting Limit (default)
% T	Percent Transmittance
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
°C	Degrees Celcius
AO	Aesthetic Objective
CFU/100 mL	Colony Forming Units per 100 millilitres
CU	Colour Units (referenced against a platinum cobalt standard)
MAC	Maximum Acceptable Concentration (health based)
mg/L	Milligrams per litre
NTU	Nephelometric Turbidity Units
OG	Operational Guideline (treated water)
pH units	pH < 7 = acidic, pH > 7 = basic
µS/cm	Microsiemens per centimetre
ASTM	ASTM International Test Methods
EPA	United States Environmental Protection Agency Test Methods
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

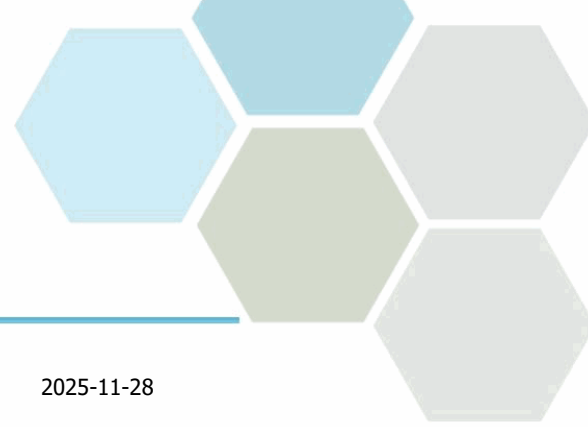

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

General Comments:

For assistance reading your report, please visit

<https://www.caro.ca/wp-content/uploads/2020/07/How-to-read-your-report-1.pdf>

For information about bacteria in water results, please visit

<https://www.caro.ca/you-need-to-know-about-bacteria-in-water-analytical-report/>

The results in this report apply to samples received by CARO and analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety and must not be modified. CARO is not responsible for losses or damages resulting directly or indirectly from errors or omissions in the conduct of the testing. Any liability is limited to the cost of analysis. CARO will dispose of all samples within 30 days of sample receipt, unless otherwise agreed.

Results in **Bold** indicate values that are above CARO's method reporting limits. Results in **red** indicate values above the regulatory limits where these have been included. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method uncertainty or regulatory limits to be included on your report, please contact your Account Manager: hhannaoui@caro.ca

Regulatory limits are added to test reports on request and are as a convenience only. While CARO makes every effort to ensure accuracy of regulatory limits, CARO assumes no liability for the use of this information. It remains the client's responsibility to ensure that regulatory limits are correct for their circumstances.

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

The following section displays the quality control (QC) data that is associated with your sample data. Groups of samples are prepared in "batches" and analyzed in conjunction with QC samples that ensure your data is of the highest quality. Common QC types include:

- **Method Blank (Blk):** A blank sample that undergoes sample processing identical to that carried out for the test samples. Method blank results are used to assess contamination from the laboratory environment and reagents.
- **Duplicate (Dup):** An additional or second portion of a randomly selected sample in the analytical run carried through the entire analytical process. Duplicates provide a measure of the analytical method's precision (reproducibility).
- **Blank Spike (BS):** A sample of known concentration which undergoes processing identical to that carried out for test samples, also referred to as a laboratory control sample (LCS). Blank spikes provide a measure of the analytical method's accuracy.
- **Matrix Spike (MS):** A second aliquot of sample is fortified with a known concentration of target analytes and carried through the entire analytical process. Matrix spikes evaluate potential matrix effects that may affect the analyte recovery.
- **Reference Material (SRM):** A homogenous material of similar matrix to the samples, certified for the parameter(s) listed. Reference Materials ensure that the analytical process is adequate to achieve acceptable recoveries of the parameter(s) tested.

Each QC type is analyzed at a 5-10% frequency, i.e. one blank/duplicate/spike for every 10-20 samples. For all types of QC, the specified recovery (% Rec) and relative percent difference (RPD) limits are derived from long-term method performance averages and/or prescribed by the reference method.

Analyte	Result	MRL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
Anions, Batch B5K4195									
Blank (B5K4195-BLK1)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Chloride	< 0.10	0.10 mg/L							
Fluoride	< 0.10	0.10 mg/L							
Nitrate (as N)	< 0.010	0.010 mg/L							
Nitrite (as N)	< 0.010	0.010 mg/L							
Sulfate	< 1.0	1.0 mg/L							
LCS (B5K4195-BS1)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Chloride	16.1	0.10 mg/L	16.0		100	90-110			
Fluoride	4.03	0.10 mg/L	4.00		101	88-108			
Nitrate (as N)	4.06	0.010 mg/L	4.00		102	90-110			
Nitrite (as N)	2.05	0.010 mg/L	2.00		102	85-115			
Sulfate	16.0	1.0 mg/L	16.0		100	90-110			
General Parameters, Batch B5K4250									
Blank (B5K4250-BLK1)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Turbidity	< 0.10	0.10 NTU							
LCS (B5K4250-BS1)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Turbidity	149	0.10 NTU	151		99	90-110			
General Parameters, Batch B5K4265									
Blank (B5K4265-BLK1)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Carbon, Total Organic	< 0.50	0.50 mg/L							
Blank (B5K4265-BLK2)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Carbon, Total Organic	< 0.50	0.50 mg/L							
LCS (B5K4265-BS1)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Carbon, Total Organic	11.1	0.50 mg/L	10.0		111	78-116			
LCS (B5K4265-BS2)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Carbon, Total Organic	11.0	0.50 mg/L	10.0		110	78-116			

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Analyte	Result	MRL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
General Parameters, Batch B5K4288									
Blank (B5K4288-BLK1)				Prepared: 2025-11-24, Analyzed: 2025-11-24					
UV Transmittance @ 254 nm - Unfiltered	< 0.10	0.10 % T							
LCS (B5K4288-BS1)				Prepared: 2025-11-24, Analyzed: 2025-11-24					
UV Transmittance @ 254 nm - Unfiltered	44.1	0.10 % T	44.8		98	95-105			
General Parameters, Batch B5K4316									
Blank (B5K4316-BLK1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Cyanide, Total	< 0.0020	0.0020 mg/L							
LCS (B5K4316-BS1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Cyanide, Total	0.0171	0.0020 mg/L	0.0200		85	82-120			
Matrix Spike (B5K4316-MS1)				Source: 25K0075-01		Prepared: 2025-11-25, Analyzed: 2025-11-25			
Cyanide, Total	0.0436	0.0020 mg/L	0.0400	< 0.0020	109	70-130			
General Parameters, Batch B5K4320									
Blank (B5K4320-BLK1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Alkalinity, Total (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Phenolphthalein (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Bicarbonate (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Carbonate (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Hydroxide (as CaCO ₃)	< 1.0	1.0 mg/L							
Conductivity (EC)	< 2.0	2.0 µS/cm							
Temperature, at pH	20.4	°C							
Blank (B5K4320-BLK2)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Alkalinity, Total (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Phenolphthalein (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Bicarbonate (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Carbonate (as CaCO ₃)	< 1.0	1.0 mg/L							
Alkalinity, Hydroxide (as CaCO ₃)	< 1.0	1.0 mg/L							
Conductivity (EC)	< 2.0	2.0 µS/cm							
Temperature, at pH	21.1	°C							
LCS (B5K4320-BS1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Alkalinity, Total (as CaCO ₃)	98.3	1.0 mg/L	100		98	80-120			
LCS (B5K4320-BS3)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Alkalinity, Total (as CaCO ₃)	98.7	1.0 mg/L	100		99	80-120			
Reference (B5K4320-SRM1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
pH	7.02	0.10 pH units	7.01		100	98-102			
Reference (B5K4320-SRM2)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
pH	7.02	0.10 pH units	7.01		100	98-102			
General Parameters, Batch B5K4326									
Blank (B5K4326-BLK1)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Ammonia, Total (as N)	< 0.050	0.050 mg/L							
Blank (B5K4326-BLK2)				Prepared: 2025-11-25, Analyzed: 2025-11-25					
Ammonia, Total (as N)	< 0.050	0.050 mg/L							

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Analyte	Result	MRL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
General Parameters, Batch B5K4326, Continued									
LCS (B5K4326-BS1)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Ammonia, Total (as N)	0.976	0.050 mg/L	1.00		98	85-115			
LCS (B5K4326-BS2)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Ammonia, Total (as N)	0.984	0.050 mg/L	1.00		98	85-115			
Duplicate (B5K4326-DUP1)			Source: 25K0075-01		Prepared: 2025-11-25, Analyzed: 2025-11-25				
Ammonia, Total (as N)	< 0.050	0.050 mg/L		< 0.050				15	
Matrix Spike (B5K4326-MS1)			Source: 25K0075-01		Prepared: 2025-11-25, Analyzed: 2025-11-25				
Ammonia, Total (as N)	0.214	0.050 mg/L	0.204	< 0.050	105	75-125			
General Parameters, Batch B5K4360									
Blank (B5K4360-BLK1)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Colour, True	< 5.0	5.0 CU							
LCS (B5K4360-BS1)			Prepared: 2025-11-25, Analyzed: 2025-11-25						
Colour, True	20	5.0 CU	20.0		99	85-115			
General Parameters, Batch B5K4529									
Blank (B5K4529-BLK1)			Prepared: 2025-11-26, Analyzed: 2025-11-27						
Nitrogen, Total Kjeldahl	< 0.050	0.050 mg/L							
Blank (B5K4529-BLK2)			Prepared: 2025-11-26, Analyzed: 2025-11-27						
Nitrogen, Total Kjeldahl	< 0.050	0.050 mg/L							
LCS (B5K4529-BS1)			Prepared: 2025-11-26, Analyzed: 2025-11-27						
Nitrogen, Total Kjeldahl	0.965	0.050 mg/L	1.00		96	85-115			
LCS (B5K4529-BS2)			Prepared: 2025-11-26, Analyzed: 2025-11-27						
Nitrogen, Total Kjeldahl	0.970	0.050 mg/L	1.00		97	85-115			
General Parameters, Batch B5K4606									
Blank (B5K4606-BLK2)			Prepared: 2025-11-27, Analyzed: 2025-11-27						
Phosphorus, Total (as P)	< 0.0050	0.0050 mg/L							
LCS (B5K4606-BS2)			Prepared: 2025-11-27, Analyzed: 2025-11-27						
Phosphorus, Total (as P)	0.106	0.0050 mg/L	0.100		106	85-115			
Microbiological Parameters, Batch B5K4272									
Blank (B5K4272-BLK1)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Coliforms, Total	< 1	1 CFU/100 mL							
E. coli	< 1	1 CFU/100 mL							
Blank (B5K4272-BLK2)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Coliforms, Total	< 1	1 CFU/100 mL							
E. coli	< 1	1 CFU/100 mL							
Blank (B5K4272-BLK3)			Prepared: 2025-11-24, Analyzed: 2025-11-24						
Coliforms, Total	< 1	1 CFU/100 mL							
E. coli	< 1	1 CFU/100 mL							

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Analyte	Result	MRL	Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
---------	--------	-----	-------	-------------	---------------	-------	-----------	-------	-----------	-------

Microbiological Parameters, Batch B5K4272, Continued

Blank (B5K4272-BLK4)

Prepared: 2025-11-24, Analyzed: 2025-11-24

Coliforms, Total	< 1	1	CFU/100 mL
E. coli	< 1	1	CFU/100 mL

Blank (B5K4272-BLK5)

Prepared: 2025-11-24, Analyzed: 2025-11-24

Coliforms, Total	< 1	1	CFU/100 mL
E. coli	< 1	1	CFU/100 mL

Blank (B5K4272-BLK6)

Prepared: 2025-11-24, Analyzed: 2025-11-25

Coliforms, Total	< 1	1	CFU/100 mL
E. coli	< 1	1	CFU/100 mL

Microbiological Parameters, Batch B5K4283

Blank (B5K4283-BLK1)

Prepared: 2025-11-24, Analyzed: 2025-11-24

Background Colonies	< 1	1	CFU/100 mL
---------------------	-----	---	------------

Total Metals, Batch B5K4366

Blank (B5K4366-BLK1)

Prepared: 2025-11-25, Analyzed: 2025-11-25

Aluminum, total	< 0.0050	0.0050	mg/L
Antimony, total	< 0.00020	0.00020	mg/L
Arsenic, total	< 0.00050	0.00050	mg/L
Barium, total	< 0.0050	0.0050	mg/L
Boron, total	< 0.0500	0.0500	mg/L
Cadmium, total	< 0.000010	0.000010	mg/L
Calcium, total	< 0.20	0.20	mg/L
Chromium, total	< 0.00050	0.00050	mg/L
Copper, total	< 0.00040	0.00040	mg/L
Iron, total	< 0.010	0.010	mg/L
Lead, total	< 0.00020	0.00020	mg/L
Magnesium, total	< 0.010	0.010	mg/L
Manganese, total	< 0.00020	0.00020	mg/L
Potassium, total	< 0.10	0.10	mg/L
Selenium, total	< 0.00050	0.00050	mg/L
Sodium, total	< 0.10	0.10	mg/L
Strontium, total	< 0.0010	0.0010	mg/L
Uranium, total	< 0.000020	0.000020	mg/L
Zinc, total	< 0.0040	0.0040	mg/L

Blank (B5K4366-BLK2)

Prepared: 2025-11-25, Analyzed: 2025-11-25

Aluminum, total	< 0.0050	0.0050	mg/L
Antimony, total	< 0.00020	0.00020	mg/L
Arsenic, total	< 0.00050	0.00050	mg/L
Barium, total	< 0.0050	0.0050	mg/L
Boron, total	< 0.0500	0.0500	mg/L
Cadmium, total	< 0.000010	0.000010	mg/L
Calcium, total	< 0.20	0.20	mg/L
Chromium, total	< 0.00050	0.00050	mg/L
Copper, total	< 0.00040	0.00040	mg/L
Iron, total	< 0.010	0.010	mg/L
Lead, total	< 0.00020	0.00020	mg/L
Magnesium, total	< 0.010	0.010	mg/L
Manganese, total	< 0.00020	0.00020	mg/L
Potassium, total	< 0.10	0.10	mg/L
Selenium, total	< 0.00050	0.00050	mg/L
Sodium, total	< 0.10	0.10	mg/L

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO Keith Macaulay (New Denver, Village of)
CARO WO# 25K0075

REPORTED 2025-11-28

Analyte	Result	MRL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
---------	--------	-----------	-------------	---------------	-------	-----------	-------	-----------	-------

Total Metals, Batch B5K4366, Continued

Blank (B5K4366-BLK2), Continued

Prepared: 2025-11-25, Analyzed: 2025-11-25

Strontium, total	< 0.0010	0.0010 mg/L							
Uranium, total	< 0.000020	0.000020 mg/L							
Zinc, total	< 0.0040	0.0040 mg/L							

LCS (B5K4366-BS1)

Prepared: 2025-11-25, Analyzed: 2025-11-25

Aluminum, total	3.88	0.0050 mg/L	4.00		97	80-120			
Antimony, total	0.0375	0.00020 mg/L	0.0400		94	80-120			
Arsenic, total	0.385	0.00050 mg/L	0.400		96	80-120			
Barium, total	0.0402	0.0050 mg/L	0.0400		100	80-120			
Boron, total	0.396	0.0500 mg/L	0.400		99	80-120			
Cadmium, total	0.0389	0.000010 mg/L	0.0400		97	80-120			
Calcium, total	4.00	0.20 mg/L	4.00		100	80-120			
Chromium, total	0.0389	0.00050 mg/L	0.0400		97	80-120			
Cobalt, total	0.0394	0.00010 mg/L	0.0400		98	80-120			
Copper, total	0.0393	0.00040 mg/L	0.0400		98	80-120			
Iron, total	4.00	0.010 mg/L	4.00		100	80-120			
Lead, total	0.0398	0.00020 mg/L	0.0400		100	80-120			
Magnesium, total	3.99	0.010 mg/L	4.00		100	80-120			
Manganese, total	0.0396	0.00020 mg/L	0.0400		99	80-120			
Molybdenum, total	0.0387	0.00010 mg/L	0.0400		97	80-120			
Nickel, total	0.0395	0.00040 mg/L	0.0400		99	80-120			
Potassium, total	3.97	0.10 mg/L	4.00		99	80-120			
Selenium, total	0.389	0.00050 mg/L	0.400		97	80-120			
Sodium, total	3.98	0.10 mg/L	4.00		100	80-120			
Strontium, total	0.0387	0.0010 mg/L	0.0400		97	80-120			
Uranium, total	0.0408	0.000020 mg/L	0.0400		102	80-120			
Zinc, total	0.387	0.0040 mg/L	0.400		97	80-120			

LCS (B5K4366-BS2)

Prepared: 2025-11-25, Analyzed: 2025-11-25

Aluminum, total	3.88	0.0050 mg/L	4.00		97	80-120			
Antimony, total	0.0373	0.00020 mg/L	0.0400		93	80-120			
Arsenic, total	0.381	0.00050 mg/L	0.400		95	80-120			
Barium, total	0.0388	0.0050 mg/L	0.0400		97	80-120			
Boron, total	0.392	0.0500 mg/L	0.400		98	80-120			
Cadmium, total	0.0390	0.000010 mg/L	0.0400		97	80-120			
Calcium, total	3.92	0.20 mg/L	4.00		98	80-120			
Chromium, total	0.0385	0.00050 mg/L	0.0400		96	80-120			
Cobalt, total	0.0390	0.00010 mg/L	0.0400		97	80-120			
Copper, total	0.0389	0.00040 mg/L	0.0400		97	80-120			
Iron, total	3.95	0.010 mg/L	4.00		99	80-120			
Lead, total	0.0400	0.00020 mg/L	0.0400		100	80-120			
Magnesium, total	3.88	0.010 mg/L	4.00		97	80-120			
Manganese, total	0.0393	0.00020 mg/L	0.0400		98	80-120			
Molybdenum, total	0.0384	0.00010 mg/L	0.0400		96	80-120			
Nickel, total	0.0394	0.00040 mg/L	0.0400		98	80-120			
Potassium, total	3.95	0.10 mg/L	4.00		99	80-120			
Selenium, total	0.381	0.00050 mg/L	0.400		95	80-120			
Sodium, total	3.93	0.10 mg/L	4.00		98	80-120			
Strontium, total	0.0387	0.0010 mg/L	0.0400		97	80-120			
Uranium, total	0.0396	0.000020 mg/L	0.0400		99	80-120			
Zinc, total	0.383	0.0040 mg/L	0.400		96	80-120			

Total Metals, Batch B5K4486

Blank (B5K4486-BLK1)

Prepared: 2025-11-26, Analyzed: 2025-11-26

Mercury, total	< 0.000010	0.000010 mg/L							
----------------	------------	---------------	--	--	--	--	--	--	--



APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO CARO WO#		Keith Macaulay (New Denver, Village of) 25K0075			REPORTED 2025-11-28					
Analyte	Result	MRL	Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Notes
Total Metals, Batch B5K4486, Continued										
Blank (B5K4486-BLK2)					Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	< 0.000010	0.000010	mg/L							
Blank (B5K4486-BLK3)					Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	< 0.000010	0.000010	mg/L							
LCS (B5K4486-BS1)					Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	0.00243	0.000010	mg/L	0.00250		97	80-120			
LCS (B5K4486-BS2)					Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	0.00256	0.000010	mg/L	0.00250		102	80-120			
LCS (B5K4486-BS3)					Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	0.00265	0.000010	mg/L	0.00250		106	80-120			
Matrix Spike (B5K4486-MS1)			Source: 25K0075-01		Prepared: 2025-11-26, Analyzed: 2025-11-26					
Mercury, total	0.00224	0.000010	mg/L	0.00250	< 0.000010	90	70-130			